




- NOTES:
1. THE RIGHT SIDE OF THE GENERATOR IS SERVICE ACCESSIBLE.
  2. 6 AMP BATTERY CHARGER
  3. IZOVAC ENGINE BLOCK HEATER.
  4. GENERATOR MUST BE GROUNDED.
  5. SOUND ATTENUATED ENCLOSURE STANDARD WITH GENERATOR.
  6. MUST ALLOW FREE FLOW OF DISCHARGE AIR AND EXHAUST.
  7. MUST ALLOW FREE FLOW OF INTAKE AIR.
  8. EASY ACCESS SERVICE PANEL IS LOCATED ON THE RIGHT SIDE OF THE GENERATOR ONLY.
  9. BASE TANK REQUIRES ALL STUB-UPS TO BE IN THE REAR TANK STUB-UP AREA.
  10. SEE TABLE FOR SUBBASE FUEL TANK CAPACITY.
  11. TANK EQUIPPED WITH FIRE SAFETY VALVE ON FUEL SUPPLY LINE.
  12. IT IS THE RESPONSIBILITY OF THE INSTALLATION TECHNICIAN TO ENSURE THE GENERATOR INSTALLATION COMPLIES WITH ALL APPLICABLE CODES, STANDARDS, AND REGULATIONS.
  13. GENERATOR IS INSTALLED ON A UL-142 RATE DOUBLE WALL SUBBASE FUEL TANK.

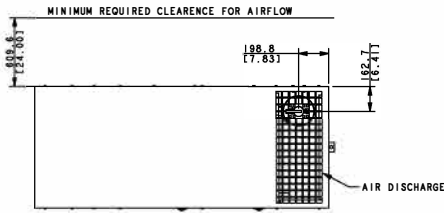


TOP VIEW

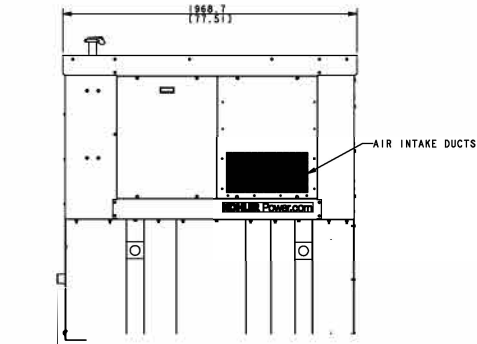

LEFT SIDE VIEW

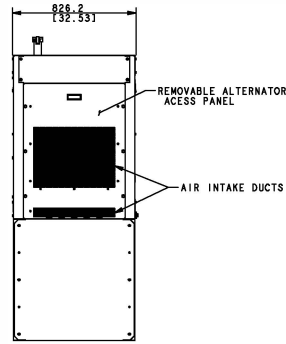

FRONT VIEW

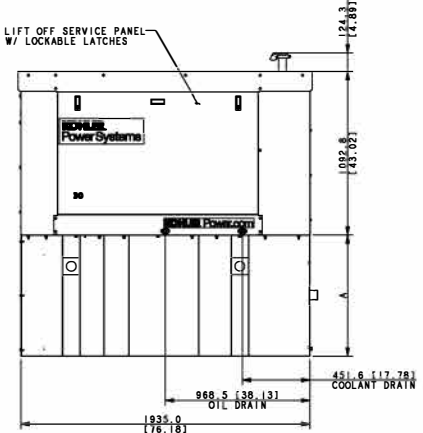

RIGHT SIDE VIEW

KOHLER 30REOZK 30kW DIESEL GENERATOR 1  
SCALE: NONE 2-8

Exhibit 8(i)  
OZAH Case No: CU 24-17



TCG BARNESVILLE SITE  
22900 OLD HUNDRED ROAD  
BARNESVILLE, MD 20838



SUBMITTALS		
DATE	DESCRIPTION	REV.
05-27-21	TOWER COMMITTEE REVIEW	
06-25-21	TOWER COMMITTEE REVIEW	
08-31-21	BOUNDARY LINE ADJUST.	

PROJECT NO: 1163.001  
DESIGNER: C.S.  
ENGINEER: M.M.

THESE DRAWINGS ARE FORMATTED TO BE FULL-SIZE AT 22"X34" SCALE AS SHOWN ON PLAN DETAIL

TITLE:  
**VZW GENERATOR DETAILS**

SHEET NUMBER:  
**Z-8**